

Optimal placement and sizing of capacitor using Limaçon inspired spider monkey optimization algorithm

Ajay Sharma¹ · Harish Sharma¹ ·
Annapurna Bhargava¹ · Nirmala Sharma¹ · Jagdish Chand Bansal²

Received: 8 January 2016 / Accepted: 4 August 2016
© Springer-Verlag Berlin Heidelberg 2016

Abstract The power system is a complex interconnected network which can be subdivided into three components: generation, distribution, and transmission. Capacitors of specific sizes are placed in the distribution network so that losses in transmission and distribution is minimum. But the decision of size and position of capacitors in this network is a complex optimization problem. In this paper, Limaçon curve inspired local search strategy (LLS) is proposed and incorporated into spider monkey optimization (SMO) algorithm to deal optimal placement and the sizing problem of capacitors. The proposed strategy is named as Limaçon inspired SMO (LSMO) algorithm. In the proposed local search strategy, the Limaçon curve equation is modified by incorporating the persistence and social learning components of SMO algorithm. The performance of LSMO is tested over 25 benchmark functions. Further, it is applied to solve optimal capacitor placement and sizing problem in IEEE-14, 30 and 33 test bus systems with the proper allocation of 3 and 5-capacitors. The reported results are compared with a network without a capacitor (un-capacitor) and other existing methods.

Keywords Spider monkey optimization · Limaçon inspired local search · Optimal capacitor placement · Capacitor sizing · Loss minimization

1 Introduction

The modern power distribution system is continuously facing ever-growing load demand, resulting in increased burden and reduced voltages. The voltages at buses or nodes reduces while moving away from a substation, due to an insufficient amount of reactive power. To improve this voltage profile, reactive compensation is required. The efficiency of power delivery is enhanced, and losses at distribution level are reduced by incorporating network reconfigurations, shunt capacitor placement, etc. The optimal capacitor placement supplies the part of reactive power demand which helps in reducing the energy losses, peak demand losses and improves the voltage profile, power factor (pf) and system stability [14]. Therefore, specific size capacitors are required to be placed at specific places in the distribution network to achieve the optimum reactive power.

To achieve this objective while maintaining the optimal economy, optimal placement of capacitor with proper sizing should be decided by some conventional [6] or non-conventional strategy [9, 14].

The shunt capacitor is a very common conventional strategy for distribution system. Further, the concept of loss minimization by a singly located capacitor was extended for multiple capacitors. Subsequently, combinational optimization strategy was developed to deal with the discrete capacitor placement problem. The described methods have their limitations of depending on the initial guess, lack of robustness, time-consuming, and many local optimal solutions for non-linear optimization problems [6].

✉ Ajay Sharma
ajay_2406@yahoo.com

Harish Sharma
hsharma@rtu.ac.in

Annapurna Bhargava
abhargava@rtu.ac.in

Nirmala Sharma
nsharma@rtu.ac.in

Jagdish Chand Bansal
jcbansal@gmail.com

¹ Rajasthan Technical University, Kota, India

² South Asian University, New Delhi, India

Swarm intelligence based meta-heuristics have impressed the researchers to apply them for solving the capacitor placement and sizing problems [24]. In past, the capacitor placement problem was solved by applying fuzzy approximate reasoning [18], genetic algorithm (GA) [29], artificial bee colony (ABC) algorithm [24], and particle swarm optimization (PSO) algorithm [23] etc. Recently, Bansal et al. [2] introduced a swarm intelligence based algorithm namely, spider monkey optimization (SMO) algorithm by taking inspiration from the social and food foraging behavior of spider monkeys. It has been shown that the SMO is competitive to the ABC, PSO, DE, and covariance matrix adaptation evolution strategies (CMA-ES) algorithms [2].

Though SMO performs well still, due to the presence of random components (ϕ and ψ) in the position update process, there is a chance of skip of the true solution. So, integration of a local search strategy with SMO may improve the exploitation capability of the algorithm and, hence reduces the chance of skipping true solution. Therefore, in this paper, a new local search algorithm is proposed by modifying the limaçon curve equation and named as limaçon inspired local search (LLS). Further, the proposed local search is incorporated with SMO in expectation of improving exploitation capability. The proposed hybridized algorithm is named as Limaçon inspired spider monkey optimization algorithm (LSMO). The performance of LSMO is tested through various numerical experiments with respect to accuracy, reliability, and consistency. Then the LSMO is applied to solve the optimal placement and sizing problem of capacitors in the distribution network. The results are compared with un-capacitor and other existing methods for IEEE 14, 30 and 33 test bus cases with 3 and 5-capacitor placement and sizing conditions.

The detailed description may be categorized as follows: Basic SMO is explained in Sect. 2. Section 3 describes a brief review on local search strategies. Limaçon inspired local search strategy was proposed and incorporated to SMO in Sect. 4. In Sect. 5, the performance of proposed strategy is evaluated. Section 6 describes capacitor sizing and optimal allocation problem. Solution to the optimal placement and sizing problem of the capacitor is presented in Sect. 7. Finally, the conclusion of the work is given in Sect. 8.

2 Spider monkey optimization (SMO) Algorithm

SMO algorithm is based on the foraging behavior and social structure of spider monkeys [2]. Spider monkeys have been categorized as a fission-fusion social structure (FFSS) based animals, in which individuals form small, impermanent parties whose member belongs to a larger community. Monkeys split themselves from larger to smaller groups and vice versa based on scarcity and availability of food.

2.1 Main steps of SMO algorithm

The SMO algorithm consists of six phases: Local leader phase, Global leader phase, Local leader learning phase, Global leader learning phase, Local leader decision phase, and Global leader decision phase. Each of the phases is explained as follows:

2.1.1 Initialization of the Population

Initially, SMO generates an equally distributed initial population of N spider monkeys where each monkey SM_i ($i = 1, 2, \dots, N$) is a D -dimensional vector and SM_i represents the i th spider monkey (SM) in the population. SM represents the potential solution of the problem under consideration. Each SM_i is initialized as follows:

$$SM_{ij} = SM_{minj} + U(0, 1) \times (SM_{maxj} - SM_{minj}) \quad (1)$$

where SM_{minj} and SM_{maxj} are respectively lower and upper bounds of SM_i in j th direction and $U(0, 1)$ is a uniformly distributed random number in the range $[0, 1]$.

2.1.2 Local leader phase (LLP)

In this phase, each SM updates its current position based on gathered information from local leader as well as local group members. The fitness value of so obtained new position is computed. If the fitness value of the new position is superior to the old position, then the SM modifies its position with the new one. The position update equation for i th SM (which is a member of k th local group) in this phase is

$$SM_{newij} = SM_{ij} + U(0, 1) \times (LL_{kj} - SM_{ij}) + U(-1, 1) \times (SM_{rj} - SM_{ij}) \quad (2)$$

where SM_{ij} is the j th dimension of the i th SM, LL_{kj} represents the j th dimension of the k th local group leader position. SM_{rj} is the j th dimension of the r th SM which is chosen arbitrarily within k th group such that $r \neq i$. $U(0, 1)$ is a uniformly distributed random number between 0 and 1. Algorithm 1 shows position update process in the local leader phase. In Algorithm 1, MG is the maximum number of groups in the swarm and pr is the perturbation rate which controls the amount of perturbation in the current position.

2.1.3 Global leader phase (GLP)

In this phase, all SMs update their positions using knowledge of global leader and local group members experience. The position update equation for this phase is as follows:

Algorithm 1 Position update process in Local Leader Phase:

```

for each  $k \in \{1, \dots, MG\}$  do
  for each member  $SM_i \in k^{th}$  group do
    for each  $j \in \{1, \dots, D\}$  do
      if  $U(0, 1) \geq pr$  then
         $SM_{newij} = SM_{ij} + U(0, 1) \times (LL_{kj} - SM_{ij}) + U(-1, 1) \times (SM_{rj} - SM_{ij})$ 
      else
         $SM_{newij} = SM_{ij}$ 
      end if
    end for
  end for
end for

```

$$SM_{newij} = SM_{ij} + U(0, 1) \times (GL_j - SM_{ij}) + U(-1, 1) \times (SM_{rj} - SM_{ij}) \tag{3}$$

where GL_j is the j th dimension of the global leader position and j is the randomly chosen index. The positions of spider monkeys (SM_i) are updated based on a probability $prob_i$ which is a function of fitness. In this way, a better candidate will have more chance to make it better. The probability $prob_i$ is calculated as shown in Eq. 4 [27].

$$prob_i = 0.9 \times \frac{fitness_i}{max_fitness} + 0.1, \tag{4}$$

Here $fitness_i$ is the fitness value of i th SM and $max_fitness$ is the highest fitness in the group. The fitness of the newly generated SM_s is calculated and compared with the old one, and the better position is adopted. The position update process of this phase is explained in Algorithm 2.

Algorithm 2 Position update process in global leader phase (GLP):

```

for  $k = 1$  to  $MG$  do
   $count = 1$ ;
   $GS = k^{th}$  group size;
  while  $count < GS$  do
    for  $i = 1$  to  $GS$  do
      if  $U(0, 1) < prob_i$  then
         $count = count + 1$ .
        Randomly select  $j \in \{1 \dots D\}$ .
        Randomly select  $SM_r$  from  $k^{th}$  group s.t.  $r \neq i$ .
         $SM_{newij} = SM_{ij} + U(0, 1) \times (GL_j - SM_{ij}) + U(-1, 1) \times (SM_{rj} - SM_{ij})$ .
      end if
    end for
    if  $i$  is equal to  $GS$  then
       $i = 1$ ;
    end if
  end while
end for

```

2.1.4 Global leader learning phase (GLLP)

In this phase, the position of the SM having best fitness in the population is selected as the updated position of the global leader using greedy selection. Further, the position of global leader is checked whether it is updating or not and if not then the global limit count is incremented by 1.

2.1.5 Local leader learning phase (LLLP)

In this phase, the position of the SM having best fitness in that group is selected as the updated position of the local leader using greedy selection. Next, if the modified position of the local leader is compared with the old one and if the local leader is not updated then the local limit count is incremented by 1.

2.1.6 Local leader decision phase (LLDP)

If any local leader is not updated up to a preset threshold called local leader limit, then all the members of that minor group update their positions either by random initialization or by using combined information from global leader and local leader through Eq. 5.

$$SM_{newij} = SM_{ij} + U(0, 1) \times (GL_j - SM_{ij}) + U(0, 1) \times (SM_{ij} - LL_{kj}); \tag{5}$$

It is clear from Eq. (5) that the updated dimension of this SM is attracted towards global leader and repels from the local leader.

2.1.7 Global leader decision (GLD) phase

In this phase, the global leader is monitored, and if it is not updated up to a preset number of iterations called global leader limit, then the global leader divides the population into minor groups. Firstly, the population is divided into two groups and then three groups and so on till the maximum number of groups (MG) are formed. After every division, LLL process is initiated to choose the local leader in the newly formed groups. The case in which a maximum number of groups are formed and even then the position of global leader is not updated then the global leader combines all the minor groups to form a single group.

The SMO algorithm is better represented by pseudo-code in Algorithm 3.

3 Significant recent local search modifications

A local search is thought of as an algorithmic structure converging to the closest local optimum while the global search

Algorithm 3 SMO

```

Initialize parameters;
while Termination criteria do
  Step 1: Local Leader Phase.
  Step 2: Global Leader Phase.
  Step 3: Local Leader Learning Phase.
  Step 4: Global Leader Learning Phase.
  Step 5: Local Leader Decision Phase.
  Step 6: Global Leader Decision Phase.
end while
Print best solution.

```

should have the potential of detecting the global optimum. Therefore, to maintain the proper balance between exploration and exploitation behavior of an algorithm, it is always suggested to incorporate a local search approach in the basic population-based algorithm to exploit the identified region in a given search space. Therefore, the local search algorithms are applied to the global search algorithms to improve the exploitation capability of the global search algorithm. Here the main algorithm explores while the local search exploits the search space.

Researchers are constantly working in the field of memetic search approach. Natalio and Gustafson [11] discussed proofs of memetic concepts. Ong et al. [22], proposed a technique to maintain a balance between genetic search and local search. Ong et al. [21], listed classification of memes adaptation by the mechanism used and the level of historical knowledge on the memes employed. Lim presented a valuable discussion on memetic computing [15]. In the same year, Neri et al. [17], incorporated scale factor local search to improve exploitation capability of DE. Further Nguyen et al. [19], presented a novel probabilistic memetic framework to model MAs as a process involving in finalizing separate actions of evolution or individual learning and analyzing the probability of each process in locating the global optimum. Ong et al. [20] presented, an article to show several deployments of memetic computing methodologies to solve complex real world problems. In same year Mininno et al. [16] incorporated Memetic approach with DE in noisy optimization. Chen et al. [3], presented realization of memetic computing through memetic algorithm. Sharma et al. [26], included opposition based lévy flight local search with ABC. Sharma et al. [27], integrated lévy flight local search strategy with artificial bee colony algorithm. Recently, in 2016 Sharma et al. presented power law based local search in SMO (PLSMO) algorithm [25]. In the above presented local search strategies, the direction and distance (step size) of the individuals, which are going to update, are based on the inter-individual distance among the solutions. This may force the individuals to move towards a specific direction. Therefore, development of local search strategy, which properly exploit the identified search space is highly required. An angular rotation based search process may reduce the chance

of trapping in a local optima. Therefore, in this paper limaçon curve inspired local search strategy (LLS) is developed and incorporated with SMO algorithm. In the proposed LLS, the direction and distance of the solutions are based on the fitness of the solution (sign), the distance between the individual, and an angle of rotation.

4 Limaçon inspired local search strategy and it's incorporation to SMO

The word *limaçon* is a Latin word meaning snail. During it's evolution, two important features were adapted by Limaçon or snail naturally. In the first process called torsion, most of the internal organs were twisted 180° anticlockwise. The another important feature is that the shell became more conical and then spirally coils. The shell is a line of defence for the limaçon. The foot of limaçon allows it to move forward and backward with muscle contracting and expanding movement with the help of mucus and slime. The limaçon's basic specifications are the height of shell, width of shell, height of aperture, width of the aperture, the number of whorls, and apical angle. In this context, the height of the shell is it's maximum measurement along the central axis. The width is the maximum measurement of the shell at right angles to the central axis. The central axis is an imaginary axis along the length of a shell, around which, in a coiled shell the whorls spiral. The central axis passes through the columella, the central pillar of the shell. Normally the whorls are circular or elliptical, but from compression and other causes a variety of forms can result. The spire can be high or low, broad or slender according to the way the coils of the shells are arranged and the apical angle of the shell varies accordingly. The whorls overlap the earlier whorls, such that they may be largely or wholly covered by the later ones. When an angulation occurs, the space between it and the suture above it constitute the area known as the shoulder of the shell. The shoulder angle may be simple or keeled, and may sometimes have nodes or spines. The limaçon and its single line diagram are shown in Fig. 1.

The proposed local search strategy is based on the limaçon curve. The limaçon curve was introduced by Etienne Pascal (1588–1651) [5]. The Limaçon curve is a botanical curve which resembles the snail. Here, both rolling circles are having the same radius and the curve thus obtained “epicycloid” is the traces of a point P fixed to a circle that rolls around another circle as shown in Fig. 2.

In literature, this curve already has been used in different ways [12]. But, in this paper, the first time the limaçon curve is used to develop a local search strategy and hybridized with the basic SMO to improve the exploitation capability of SMO.

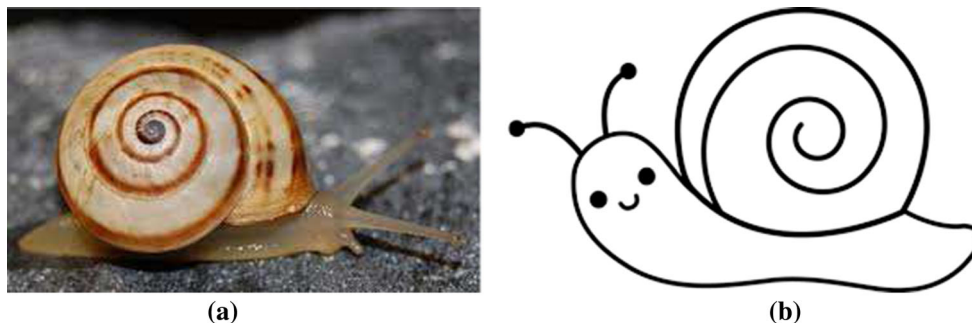


Fig. 1 **a** Limaçon (Snail) curve (this figure is accessed on Feb 2015 from <http://entnemdept.ufl.edu/creatures/misc/whitegardensnail.htm>), **b** single line curve (this figure is accessed on Feb. 2015 from <http://www.clipartpanda.com/categories/snail-clipart-black-andwhite>)

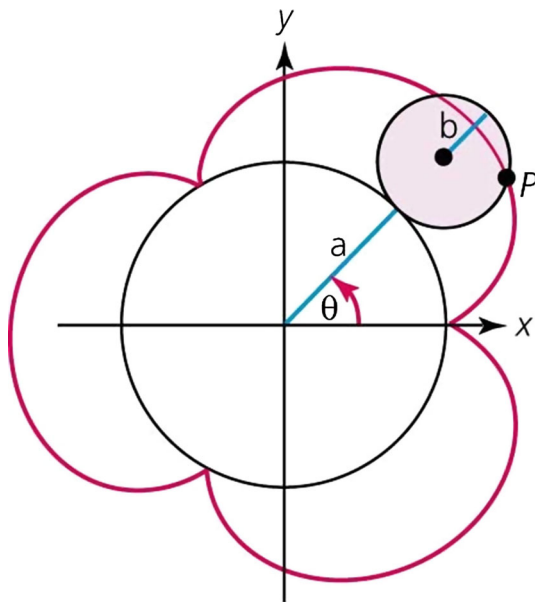


Fig. 2 Epicycloid curve (this figure is accessed on Feb 2015 from <http://cf.ydcdn.net/1.0.1.42/images/main/epicycloid.jpg>)

The basic equations of limaçon curve are shown in equations 6 and 7 for vertical axis and horizontal axis curves respectively [30].

$$r = a \pm b \sin \theta \tag{6}$$

$$r = a \pm b \cos \theta \tag{7}$$

Here, r is the distance of the limaçon from the origin, a and b are constants and θ is an angle of rotation. The curve has transient phases based on the value of b . From a circle, for $b = 0$ to cardioid for $b = 1$ and a noose on curve appears for $b > a$.

In this paper, this limaçon curve is used to form a local search strategy into SMO. In the proposed local search strategy, the distance r is used as a new position of a solution which is going to update its position during the search process

in the given search region. The detailed description of the proposed limaçon curve based local search strategy, named as limaçon local search (LLS) strategy is as follows:

In the proposed LLS, Eq. 6 of limaçon curve is adapted with some modifications as a position update equation of the proposed local search strategy. The modified equation is as follows:

$$x_{new} = x_i \pm (x_i - x_k) \times \sin \theta \quad \text{where,} \\ k \in \text{randomly selected solution, but } k \neq i. \tag{8}$$

Here, $a = x_i$ is the solution which is going to update its position, x_{new} is the updated position of the x_i , $b = (x_i - x_k)$ is the social influence of the solution x_i in the population and θ is an angle of rotation.

In this paper, in each iteration, only the best solution will be allowed to update its position using the LLS strategy. The position update equation for the best solution is given by Eq. 9.

$$x_{new} = x_{best} \pm (x_{best} - x_k) \times \sin \theta \tag{9}$$

where θ is calculated as

$$\theta = \frac{\pi}{2} \times \left(1 - \frac{t}{T} \right) \tag{10}$$

Where, t = current iteration counter and T = total iterations of local search. The pseudo-code of the proposed LLS is shown in Algorithm 4.

As the step size is also based on sine of an angle, resembling apical angle of limaçon, the step size reduces based on decreasing angular values from $\theta = 90^\circ$ to $\theta = 0^\circ$ either in negative or positive direction. The higher height of spire shows a lesser apical angle for limaçon and vice versa. Similarly, the lesser angular step represents a small step size, while the higher angular step represents larger step size in the LLS strategy. This implies that in early iterations larger

step sizes are allowed while smaller step sizes are allowed in later iterations.

Algorithm 4 Limaçon local search (LLS) strategy:

```

Input optimization function  $Min f(x)$  and  $x_{best}$ ;
Initialized iteration counter  $t = 0$  and total iterations of LLS,  $T$ ;
while  $t < T$  do
  Calculate the value of  $\theta$  using equation (10);
  Generate new solutions  $x_{new1}$  using  $Sign = "-"$  and  $x_{new2}$  using
   $Sign = "+"$  by Algorithm 5.
  Calculate objective value  $f(x_{new1})$  and  $f(x_{new2})$ .
  if  $f(x_{new1}) < f(x_{best})$  then
     $x_{best} = x_{new1}$ ;
  else if  $f(x_{new2}) < f(x_{best})$  then
     $x_{best} = x_{new2}$ ;
  end if
end while
Return  $x_{best}$ .

```

In Algorithms 4 and 5, c_r is a perturbation rate (a number between 0 and 1) which controls the amount of perturbation in the best solution, $U(0, 1)$ is a uniform distributed random number between 0 and 1, D is the dimension of the problem and x_k is a randomly selected solution within population. See Sect. 5.1 for details of these parameter settings.

The proposed LLS strategy is incorporated with the SMO after the global leader decision phase. The pseudo-code of the modified SMO named as limaçon inspired SMO (LSMO) algorithm is shown in Algorithm 6.

Algorithm 5 New solution generation:

```

Input  $Sign$  and best solution  $x_{best}$ ;
Randomly select a solution  $x_k$  from the population such that  $best \neq k$ ;
for  $j = 1$  to  $D$  do
  if  $U(0, 1) < c_r$  then
     $x_{newj} = x_{bestj}$ ;
  else
     $x_{newj} = x_{bestj} + Sign(x_{bestj} - x_{kj}) \times \sin\theta$ ;
  end if
end for
Return  $x_{new}$ 

```

Algorithm 6 Limaçon inspired SMO:

```

Initialize the parameters;
while Termination criteria do
  Step 1: Local Leader phase.
  Step 2: Global Leader phase.
  Step 3: Local Leader Learning phase.
  Step 4: Global Leader Learning phase.
  Step 5: Local Leader Decision phase.
  Step 6: Global Leader Decision phase.
  Step 7: Apply Limaçon inspired Local Search (LLS) Strategy using
  Algorithm 4.
end while
Print best solution.

```

5 Performance evaluation of LSMO algorithm

The performance of proposed *LSMO* algorithm is evaluated on 25 different benchmark continuous optimization functions (f_1 to f_{25}) having different degrees of complexity and multimodality as shown in Table 1. The acceptable errors of above functions are set to see the clear difference among the considered algorithms in terms of success rate and number of function evolutions. Here, the functions and acceptable errors are adopted from the literature [1, 2, 27]. To check the competitiveness of *LSMO*, it is compared with *SMO* [2], *ABC* [10], *DE* [28], *PSO* – 2011 [4], *CMA – ES* [7] and one significant variant of *ABC* namely, Gbest-guided *ABC* (*GABC*) [31] as well as two local search variants namely, memetic *ABC* (*MeABC*) [1], and Lévy flight *ABC* (*LFABC*) [27] and one recent local search variant of *SMO* namely, *PLSMO* [25]. The experimental setting is given in Sect. 5.1.

5.1 Experimental setting

The experimental settings are as follows:

- Population Size $N = 50$;
- $MG = N/10$.
- $GlobalLeaderLimit = 50$,
- $LocalLeaderLimit = 1500$,
- pr (perturbation rate of main SMO algorithm) $\in [0.1, 0.4]$, linearly increasing over iterations,

$$pr_{G+1} = pr_G + (0.4 - 0.1)/MIR \quad (11)$$

where, G is the iteration counter, MIR is the maximum number of iterations.,

- The stopping criteria is either maximum number of function evaluations (which is set to be 200,000) is reached or the acceptable error of test problem has been achieved,
- The number of simulations/run = 100,
- Parameter settings for the algorithm *SMO*, *ABC*, *GABC*, *MeABC*, *LFABC*, *PLSMO*, *CMA – ES*, *PSO* – 2011, and *DE* are similar to their legitimate research papers respectively.
- The maximum number of iterations of LLS is set through sensitivity analysis in terms of sum of success rate (SR). The performance of *LSMO* is measured for considered test problems on different values of T and results in terms of success are analyzed in Fig. 3. It is clear from Fig. 3 that $T = 20$ gives better results (highest value of sum of success). Therefore in this paper maximum local search iterations is set as $T = 20$.
- In order to investigate the effect of parameter c_r (perturbation rate of local search), described by Algorithm 5 on the performance of *LSMO*, its sensitivity with respect

Table 1 Test problems

Test problem	Objective function	Search range	Optimum value	D	AE	C
Sphere	$f_1(x) = \sum_{i=1}^D x_i^2$	$[-5.12, 5.12]$	$f(0) = 0$	30	$1.0E-05$	S, U
De Jong f4	$f_2(x) = \sum_{i=1}^D i \times (x_i)^4$	$[-5.12, 5.12]$	$f(0) = 0$	30	$1.0E-05$	S, M
Cigar	$f_3(x) = x_0^2 + 100000 \sum_{i=1}^D x_i^2$	$[-10, 10]$	$f(0) = 4$	30	$1.0E-05$	S, U
brown3	$f_4(x) = \sum_{i=1}^{D-1} (x_i^{2(x_{i+1})^2+1} + x_{i+1}^{2x_i^2+1})$	$[-1, 4]$	$f(0) = 0$	30	$1.0E-05$	U, N
Schewel	$f_5(x) = \sum_{i=1}^D x_i + \prod_{i=1}^D x_i $	$[-10, 10]$	$f(0) = 0$	30	$1.0E-05$	N, U
Axis parallel hyper-ellipsoid	$f_6(x) = \sum_{i=1}^D i \times x_i^2$	$[-5.12, 5.12]$	$f(0) = 0$	30	$1.0E-05$	U, S
Sum of different powers	$f_7(x) = \sum_{i=1}^D x_i ^{i+1}$	$[-1, 1]$	$f(0) = 0$	30	$1.0E-05$	S, M
Neumaier 3 Problem (NF3)	$f_8(x) = \sum_{i=1}^D (x_i - 1)^2 - \sum_{i=2}^D x_i x_{i-1}$	$[-D^2, D^2]$	$f_{min} = -\frac{(D(D+4)(D-1))}{6}$	10	$1.0E-01$	U, N
Rotated hyper-ellipsoid	$f_9(x) = \sum_{i=1}^D \sum_{j=1}^j x_j^2$	$[-65.536, 65.536]$	$f(0) = 0$	30	$1.0E-05$	S, M
Levy montalvo 1	$f_{10}(x) = \frac{\pi}{D} (10 \sin^2(\pi y_1) + \sum_{i=1}^{D-1} (y_i - 1)^2 (1 + 10 \sin^2(\pi y_{i+1})) + (y_D - 1)^2)$, where $y_i = 1 + \frac{1}{4}(x_i + 1)$	$[-10, 10]$	$f(-1) = 0$	30	$1.0E-05$	N, M
Levy montalvo 2	$f_{11}(x) = 0.1(\sin^2(3\pi x_1) + \sum_{i=1}^{D-1} (x_i - 1)^2 \times (1 + \sin^2(3\pi x_{i+1})) + (x_D - 1)^2 (1 + \sin^2(2\pi x_D)))$	$[-5, 5]$	$f(1) = 0$	30	$1.0E-05$	N, M
Ellipsoidal	$f_{12}(x) = \sum_{i=1}^D (x_i - i)^2$	$[-D, D]$	$f(1, 2, 3, \dots, D) = 0$	30	$1.0E-05$	U, S
Beale function	$f_{13}(x) = [1.5 - x_1(1 - x_2)]^2 + [2.25 - x_1(1 - x_2^2)]^2 + [2.625 - x_1(1 - x_2^3)]^2$	$[-4.5, 4.5]$	$f(3, 0.5) = 0$	2	$1.0E-05$	N, M
Colville function	$f_{14}(x) = 100[x_2 - x_1^2]^2 + (1 - x_1)^2 + 90(x_4 - x_3^2)^2 + (1 - x_3)^2 + 10.1[(x_2 - 1)^2 + (x_4 - 1)^2] + 19.8(x_2 - 1)(x_4 - 1)$	$[-10, 10]$	$f(1) = 0$	4	$1.0E-05$	N, M
Kowalik	$f_{15}(x) = \sum_{i=1}^{11} [a_i - \frac{x_i(b_i^2 + b_i x_i)}{b_i^2 + b_i x_i + x_i}]^2$	$[-5, 5]$	$f(0.192833, 0.190836, 0.123117, 0.135766) = 0.000307486$	4	$1.0E-05$	M, N
2D Tripod function	$f_{16}(x) = p(x_2)(1 + p(x_1)) + (x_1 + 50p(x_2))(1 - 2p(x_1)) + (x_2 + 50(1 - 2p(x_2))) $	$[-100, 100]$	$f(0, -50) = 0$	2	$1.0E-04$	N, M
Shifted Sphere	$f_{17}(x) = \sum_{i=1}^D z_i^2 + f_{bias}$, $z = x - o$, $x = [x_1, x_2, \dots, x_D]$, $o = [o_1, o_2, \dots, o_D]$	$[-100, 100]$	$f(o) = f_{bias} = -450$	10	$1.0E-05$	S, M
Shifted Ackley	$f_{18}(x) = -20 \exp(-0.2 \sqrt{\frac{1}{D} \sum_{i=1}^D z_i^2}) - \exp(\frac{1}{D} \sum_{i=1}^D \cos(2\pi z_i)) + 20 + e + f_{bias}$, $z = (x - o)$, $x = (x_1, x_2, \dots, x_D)$, $o = (o_1, o_2, \dots, o_D)$	$[-32, 32]$	$f(o) = f_{bias} = -140$	10	$1.0E-05$	S, M
Easom's function	$f_{19}(x) = -\cos x_1 \cos x_2 e^{(-(x_1 - \pi)^2 - (x_2 - \pi)^2)}$	$[-10, 10]$	$f(\pi, \pi) = -1$	2	$1.0E-13$	S, M
Dekkers and Aarts	$f_{20}(x) = 10^5 x_1^2 + x_2^2 - (x_1^2 + x_2^2)^2 + 10^{-5} (x_1^2 + x_2^2)^4$	$[-20, 20]$	$f(0, 15) = f(0, -15) = -24777$	2	$5.0E-01$	N, M

Table 1 continued

Test problem	Objective function	search Range	Optimum Value	D	AE	C
McCormick	$f_{21}(x) = \sin(x_1 + x_2) + (x_1 - x_2)^2 - \frac{3}{2}x_1 + \frac{5}{2}x_2 + 1$	$-1.5 \leq x_1 \leq 4, -3 \leq x_2 \leq 3$	$f(-0.547, -1.547) = -1.9133$	30	$1.0E-04$	N, M
Meyer and Roth Problem	$f_{22}(x) = \sum_{i=1}^5 \left(\frac{x_i x_{i+1}}{1+x_i+x_{i+1}} - y_i \right)^2$	$[-10, 10]$	$f(3.13, 15.16, 0.78) = 0.4E-04$	3	$1.0E-03$	U, N
Shubert	$f_{23}(x) = -\sum_{i=1}^5 i \cos((i+1)x_i + 1) \sum_{j=1}^5 i \cos((i+1)x_2 + 1)$	$[-10, 10]$	$f(7.0835, 4.8580) = -186.7309$	2	$1.0E-05$	S, M
Sinusoidal	$f_{24}(x) = -[A \prod_{i=1}^D \sin(x_i - z) + \prod_{i=1}^D \sin(B(x_i - z))]$ $A = 2.5, B = 5, z = 30$	$[0, 180]$	$f(90 + z) = -(A + 1)$	10	$1.0E-02$	N, M
Moved axis parallel hyper-ellipsoid	$f_{25}(x) = \sum_{i=1}^D 5i \times x_i^2$	$[-5.12, 5.12]$	$f(x) = 0; x(i) = 5 \times i, i = 1 : D$	30	$1.0E-15$	U, S

D dimensions, C characteristic, U unimodal, M multimodal, S separable, N Non-separable, AE acceptable error

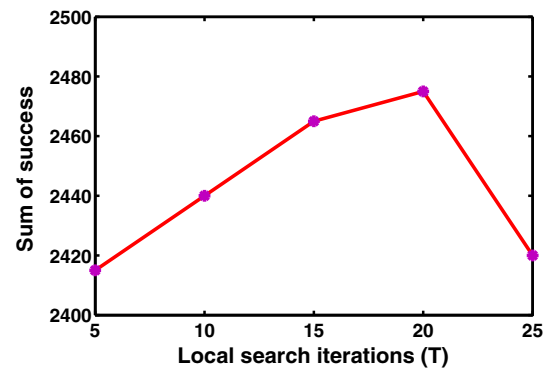


Fig. 3 Effect of LLS termination criteria T on success rate

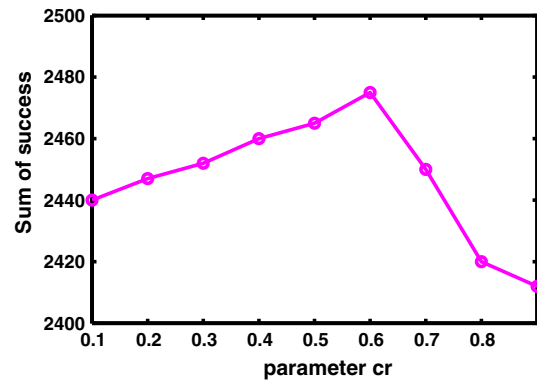


Fig. 4 Effect of parameter cr on success rate

to different values of c_r in the range $[0.1, 0.9]$, is examined in the Fig. 4. It can be observed from Fig. 4 that the algorithm is very sensitive towards c_r and value 0.6 gives comparatively better results. Therefore $c_r = 0.6$ is selected for the experiments in this paper.

5.2 Results comparison

The numerical results obtained are presented in Table 2 for success rate (SR), average number of function evaluations (AFE), mean error (ME), and standard deviation (SD).

LSMO, SMO, ABC, DE, PSO-2011, CMA-ES and one significant variant of ABC namely, GABC, and two local search variants namely, LFABC, and MeABC, and one recent local search variant of SMO namely, PLSMO are compared in terms of SR, AFE, ME, and SD as shown in Table 2. The results show that LSMO is competitive than SMO and other considered algorithms for most of the benchmark test problems irrespective of their nature either in terms of separability, modality and other parameters.

The considered algorithms are also compared through Mann-Whitney U rank sum test [27], acceleration rate and boxplot analysis. Mann-Whitney U rank sum test is applied on average number of function evaluations. For all consid-

Table 2 Comparison of the results of test problems

Test problem	Measure	LSMO	SMO	LFABC	MeABC	GABC	ABC	PLSMO	CMA-ES	PSO-2011	DE
f_1	SD	8.12E-07	8.37E-07	1.73E-06	7.87E-07	1.81E-06	2.02E-06	8.15E-07	7.98E-07	6.10E-07	8.24E-07
	ME	7.78E-06	8.87E-06	8.39E-06	9.27E-06	8.11E-06	8.17E-06	8.96E-06	8.70E-06	9.33E-06	9.06E-06
	AFE	10192.35	12642.3	16733.85	13626.8	14347.5	20409	13174.79	31604.8	38101.5	22444
	SR	100	100	100	100	100	100	100	100	100	100
f_2	SD	1.37E-06	1.20E-06	3.02E-06	1.69E-06	2.72E-06	3.11E-06	9.49E-07	1.96E-06	8.62E-07	8.51E-07
	ME	8.03E-06	8.49E-06	6.62E-06	8.26E-06	5.51E-06	4.90E-06	8.68E-06	7.37E-06	9.03E-06	9.01E-06
	AFE	8266.64	10725.66	9556.12	5516.18	8388	9578.5	11198.07	20907.6	32596.5	20859.5
	SR	100	100	100	100	100	100	100	100	100	100
f_3	SD	1.13E-06	8.98E-07	1.65E-06	8.48E-07	1.96E-06	2.20E-06	9.58E-07	9.97E-07	6.75E-07	7.51E-07
	ME	8.70E-06	8.77E-06	8.84E-06	9.15E-06	8.10E-06	7.77E-06	8.86E-06	8.76E-06	9.28E-06	9.18E-06
	AFE	19575.68	22596.75	24546.79	28443.32	23163	34887	23442.8	70154.2	68973	39676
	SR	100	100	100	100	100	100	100	100	100	100
f_4	SD	8.87E-07	7.26E-07	1.58E-06	7.70E-07	1.88E-06	2.13E-06	8.37E-07	1.25E-06	7.31E-07	7.83E-07
	ME	8.52E-06	9.02E-06	8.55E-06	9.21E-06	7.91E-06	7.84E-06	8.87E-06	8.39E-06	9.11E-06	8.99E-06
	AFE	9961.85	12703.68	16111.3	13848.76	14072	20917	13246.78	32220.5	34906.5	21947.5
	SR	100	100	100	100	100	100	100	100	100	100
f_5	SD	7.50E-07	5.45E-07	8.04E-07	3.75E-07	6.90E-07	1.03E-06	5.67E-07	5.08E-07	5.37E-07	4.90E-07
	ME	9.13E-06	9.29E-06	9.34E-06	9.58E-06	9.30E-06	9.16E-06	9.33E-06	9.39E-06	9.50E-06	9.47E-06
	AFE	21035.18	23300.64	30994.7	31451.16	27636	41646	24026.78	73331.4	70633.5	45014.5
	SR	100	100	100	100	100	100	100	100	100	100
f_6	SD	7.09E-07	8.58E-07	1.70E-06	7.12E-07	1.98E-06	2.04E-06	9.77E-07	8.90E-07	7.22E-07	8.58E-07
	ME	7.91E-06	9.01E-06	8.43E-06	9.20E-06	7.71E-06	7.96E-06	8.78E-06	8.88E-06	9.14E-06	9.03E-06
	AFE	10692.31	14728.23	18093.08	16789.28	16084.5	22672	15275.92	38151.9	44316.5	25839.5
	SR	100	100	100	100	100	100	100	100	100	100
f_7	SD	2.84E-06	1.72E-06	3.13E-06	2.87E-06	2.95E-06	2.65E-06	1.83E-06	3.27E-06	1.67E-06	1.87E-06
	ME	6.37E-06	7.64E-06	5.86E-06	5.59E-06	5.62E-06	5.16E-06	7.99E-06	7.05E-06	8.35E-06	7.42E-06
	AFE	3733.85	5153.94	7523.66	4527.08	9285	16229	5288.82	51777.2	9610	7867
	SR	100	100	100	100	100	100	100	83.33	100	100
f_8	SD	8.68E-07	3.91E-06	6.84E-02	1.06E-02	1.04E+00	6.74E-01	8.60E-07	1.82E-06	4.12E-07	1.47E-06
	ME	5.00E-06	1.06E-05	1.07E-01	8.88E-02	1.17E+00	9.22E-01	9.54E-06	7.12E-06	9.63E-06	8.05E-06
	AFE	22010.61	169949.93	39650.81	22134.93	200000	200000	109047.36	11963	67937.5	17311.5
	SR	100	91	95	100	0	0	100	100	100	100

Table 2 continued

Test problem	Measure	LSMO	SMO	LFABC	MeABC	GABC	ABC	PLSMO	CMA-ES	PSO-2011	DE
f_9	SD	1.08E-06	9.09E-07	1.99E-06	9.59E-07	1.93E-06	2.14E-06	7.86E-07	9.51E-07	7.00E-07	7.52E-07
	ME	8.58E-06	8.74E-06	8.51E-06	9.11E-06	7.85E-06	7.80E-06	8.96E-06	8.56E-06	9.24E-06	9.08E-06
	AFE	16202.15	18688.23	21192.18	22617.84	19475.5	28065	19427.76	42997.6	56112	32654
	SR	100	100	100	100	100	100	100	100	100	100
f_{10}	SD	2.51E-02	1.33E-06	1.75E-06	8.84E-07	1.84E-06	2.19E-06	1.65E-06	8.08E-07	6.51E-07	8.76E-07
	ME	4.16E-03	8.70E-06	8.27E-06	9.10E-06	8.10E-06	7.63E-06	8.69E-06	9.04E-06	9.31E-06	8.98E-06
	AFE	17292.66	16804.91	15263.63	11797.24	13077	19747	24383.43	38128.4	35539.5	19806.5
	SR	97	100	100	100	100	100	100	100	100	100
f_{11}	SD	1.53E-03	1.54E-03	1.81E-06	9.19E-07	1.65E-06	2.47E-06	2.16E-03	1.17E-06	3.15E-03	1.88E-03
	ME	2.28E-04	2.29E-04	8.05E-06	9.07E-06	7.99E-06	7.11E-06	4.49E-04	8.78E-06	9.99E-04	3.39E-04
	AFE	14794.98	18985	16857.9	12789.1	14295.5	21867.5	21667.18	32817.4	51964	25818
	SR	98	98	100	100	100	100	96	100	91	97
f_{12}	SD	1.02E-06	9.35E-07	1.97E-06	8.51E-07	1.94E-06	2.34E-06	7.74E-07	9.88E-07	7.68E-07	8.48E-07
	ME	8.10E-06	8.97E-06	8.07E-06	9.14E-06	7.82E-06	7.44E-06	9.04E-06	8.60E-06	9.25E-06	9.03E-06
	AFE	10792.78	15394.5	18653.59	17885.74	16683.5	24167	15915.57	40125.9	44293.5	27459.5
	SR	100	100	100	100	100	100	100	100	100	100
f_{13}	SD	2.83E-06	3.00E-06	2.84E-06	2.96E-06	3.04E-06	2.25E-06	2.81E-06	2.44E-06	2.87E-06	2.67E-06
	ME	4.03E-06	4.72E-06	7.52E-06	4.94E-06	5.61E-06	8.23E-06	5.36E-06	3.75E-06	4.92E-06	4.83E-06
	AFE	1748.93	1537.47	3746.11	2573.53	9335.88	16098.58	1315.74	787.1	2716	1428
	SR	100	100	100	100	100	100	100	100	100	100
f_{14}	SD	2.53E-04	2.12E-04	1.29E-03	2.31E-03	1.61E-02	1.20E-01	1.54E-04	2.07E-04	1.80E-04	4.49E-01
	ME	6.84E-04	7.68E-04	9.19E-03	6.99E-03	1.58E-02	1.74E-01	8.66E-04	6.48E-04	8.49E-04	9.13E-02
	AFE	19105.84	54551.33	65107.64	29780.95	197731.18	200000	17720.53	8173.3	51087.5	24687.5
	SR	100	100	100	100	5	0	100	100	100	90
f_{15}	SD	8.35E-05	1.16E-04	1.79E-04	1.63E-05	3.80E-05	7.97E-05	1.16E-04	7.18E-05	4.03E-05	3.57E-04
	ME	9.41E-05	1.06E-04	1.37E-04	8.46E-05	9.10E-05	1.75E-04	1.12E-04	2.50E-04	9.41E-05	3.02E-04
	AFE	37661.35	43616.57	61386.26	41583.08	93336.22	181667.37	36332.34	151.6	38705	69677
	SR	99	98	95	100	90	20	97	100	99	67
f_{16}	SD	9.47E-06	2.54E-05	2.37E-01	2.35E-05	2.61E-05	2.81E-05	2.47E-05	2.75E-07	3.01E-01	2.18E-01
	ME	1.07E-06	5.93E-05	6.01E-02	6.09E-05	6.15E-05	6.51E-05	6.69E-05	4.87E-07	1.03E-01	5.01E-02
	AFE	8925.42	14803.23	17885.73	8784.15	7949.1	8485.49	14405.7	1574	37910.5	13136.5
	SR	100	100	94	100	100	100	100	100	88	95

Table 2 continued

Test problem	Measure	LSMO	SMO	LFABC	MeABC	GABC	ABC	PLSMO	CMA-ES	PSO-2011	DE
f_{17}	SD	2.02E-06	1.73E-06	2.36E-06	1.89E-06	1.94E-06	2.50E-06	1.47E-06	1.91E-06	1.36E-06	1.74E-06
	ME	6.98E-06	7.69E-06	7.27E-06	7.64E-06	7.64E-06	6.85E-06	7.63E-06	7.26E-06	8.44E-06	7.80E-06
	AFE	6112.14	5948.91	6203.32	5587.6	5546.5	9074.5	6140.89	9665.3	15731.5	10397
	SR	100	100	100	100	100	100	100	100	100	100
f_{18}	SD	9.31E-07	9.32E-07	1.34E-06	1.49E-06	1.60E-06	1.97E-06	1.14E-06	2.35E-06	8.20E-07	8.59E-07
	ME	7.47E-06	8.66E-06	8.66E-06	8.71E-06	8.28E-06	7.79E-06	8.61E-06	5.37E-06	9.05E-06	8.99E-06
	AFE	8825.98	9055.53	10934.63	10002.68	9305.5	16842	9500.74	17365	24686.5	15527.5
	SR	100	100	100	100	100	100	100	100	100	100
f_{19}	SD	2.76E-14	2.78E-14	3.28E-14	2.08E-11	1.50E-12	8.06E-05	3.12E-14	8.17E-14	2.85E-14	2.96E-14
	ME	4.58E-14	4.81E-14	5.60E-14	2.15E-12	2.03E-13	2.71E-05	4.85E-14	7.83E-14	5.08E-14	4.92E-14
	AFE	14692.61	11829.51	14065.55	55466.86	43142.05	181234.08	11986.99	9612	9747.5	4773
	SR	100	100	100	98	99	17	100	100	100	100
f_{20}	SD	5.05E-03	5.26E-03	5.68E-03	5.37E-03	4.84E-03	5.41E-03	5.88E-03	6.07E-03	5.16E-03	5.23E-03
	ME	4.89E-01	4.90E-01	4.91E-01	4.89E-01	4.89E-01	4.89E-01	4.90E-01	7.91E-01	4.91E-01	4.90E-01
	AFE	1413.94	1232.55	687.8	783.58	785	1432.53	1229.54	1725.5	4915	2113.5
	SR	100	100	100	100	100	100	100	100	100	100
f_{21}	SD	6.69E-06	6.09E-06	6.96E-06	6.88E-06	6.38E-06	6.89E-06	7.07E-06	1.76E+00	6.36E-06	6.37E-06
	ME	8.59E-05	8.70E-05	9.04E-05	8.70E-05	8.90E-05	8.93E-05	8.79E-05	2.05E-01	8.93E-05	8.70E-05
	AFE	795.39	729.63	587.42	561.26	611.5	1204.01	724.83	258.433	1416	961
	SR	100	100	100	100	100	100	100	100	100	100
f_{22}	SD	2.64E-06	2.96E-06	3.10E-06	2.87E-06	2.91E-06	2.85E-06	2.90E-06	8.99E-04	2.68E-06	1.78E-05
	ME	1.94E-03	1.94E-03	1.95E-03	1.95E-03	1.95E-03	1.95E-03	1.95E-03	1.25E-02	1.95E-03	1.95E-03
	AFE	2337.96	1947.07	3418.07	3886.93	4809.51	31742.53	1927.24	142128	3192	7823.5
	SR	100	100	100	100	100	100	100	87	100	97
f_{23}	SD	9.41E-04	6.67E-03	1.67E-03	2.39E-03	2.36E-03	1.85E-03	1.54E-03	6.27E-06	2.77E-01	2.41E-01
	ME	1.20E-04	1.11E-02	8.35E-03	7.30E-03	7.50E-03	7.88E-03	8.37E-03	7.32E-06	3.94E-01	5.29E-01
	AFE	15291.91	161340.38	22030.31	37251.9	48341.78	50666.58	27244.63	14262	180761	199693.5
	SR	100	66	100	99	99	100	100	100	21	1
f_{24}	SD	1.05E-16	8.66E-17	1.09E-16	8.04E-17	6.06E-17	7.03E-17	9.47E-17	5.53E+00	5.85E-17	9.27E-17
	ME	8.79E-16	8.97E-16	8.75E-16	9.09E-16	9.30E-16	9.31E-16	8.96E-16	8.36E-16	9.31E-16	8.90E-16
	AFE	30109.1	34461.9	44903	45300.7	39749.5	62441.5	35773.96	199693.5	104853	59285.5
	SR	100	100	100	100	100	100	100	0	100	100
f_{25}	SD	9.21E-03	2.64E-04	1.62E+00	1.65E+00	3.88E+00	1.01E+01	1.17E-02	1.21E-16	3.12E-05	3.35E-05
	ME	5.73E-04	5.88E-05	1.03E+00	2.20E+00	6.12E+00	1.74E+01	1.21E-03	1.50E-01	2.59E-05	2.46E-05
	AFE	92344.7	110005.15	199313.43	200000	200000	200000	99717.72	91778.9	83559	66039.5
	SR	81	57	3	0	0	0	58	100	69	71

ered algorithms the test is performed at 5 % significance level ($\alpha = 0.05$) and the output results for 100 simulations are presented in Table 3. In this table ‘+’ sign indicates that *LSMO* is significantly better than the other considered algorithm while ‘-’ sign represents that the other considered algorithm is better. The *LSMO* outperforms as compared to all other considered algorithms for 10 test problems including $f_1, f_3-f_7, f_9, f_{12}, f_{18}$, and f_{24} . *LSMO* performs better than basic *SMO* for 18 test problems, $f_1-f_9, f_{11}, f_{12}, f_{14}-f_{16}, f_{18}$, and $f_{23}-f_{25}$. The *LSMO* shows better results for 24 test problems when compared with basic *ABC* algorithm, f_1-f_{15} and $f_{17}-f_{25}$. The *LSMO* performs better for 21 test problems, $f_1-f_7, f_9-f_{12}, f_{14}-f_{18}$, and $f_{20}-f_{24}$ in comparison with *DE*. The *LSMO* performs better for 23 test problems in comparison with *PSO*, f_1-f_{18} and $f_{20}-f_{24}$. In comparison with *CMA – ES*, *LSMO* performs better on 15 functions, $f_1-f_7, f_9-f_{12}, f_{17}, f_{18}, f_{20}, f_{22}$, and f_{24} . While comparing with the variants of *ABC*, the *LSMO* performs better for 19 test problems than *GABC*, $f_1-f_9, f_{12}-f_{15}, f_{18}, f_{19}, f_{22}-f_{25}$. The *LSMO* performs better than *LFABC* for 24 test problems f_1-f_9 and $f_{11}-f_{25}$. In comparison with *MeABC*, *LSMO* shows better results for 18 test problems $f_1, f_3-f_9, f_{11}-f_{14}, f_{17}, f_{18}, f_{22}-f_{25}$. The *LSMO* shows better results for 18 test problems, $f_1-f_{12}, f_{16}-f_{18}, f_{23}-f_{25}$ when compared with *PLSMO* algorithm. The above discussion represents that *LSMO* may be a competitive candidate in the field of swarm intelligence.

Further, the convergence speed of considered algorithms are compared by analysis of AFEs. There is an inverse relation between AFEs and convergence speed, for smaller AFEs the convergence speed will be higher and vice-versa. For minimizing the effects of stochastic nature of algorithm, the reported AFEs are averaged for 100 runs for each considered test problems. The convergence speed is compared using acceleration rate (AR) for the considered algorithms. The AR which is calculated as follows:

$$AR = \frac{AFE_{ALGO}}{AFE_{LSMO}}, \quad (12)$$

Here, $ALGO \in \{SMO, ABC, PSO, DE, CMA - ES, GbestABC, MeABC, LFABC, PLSMO\}$ and $AR > 1$ represents that *LSMO* is faster than the compared algorithm. The *AR* results are shown in Table 4. The results in Table 4 shows that for most of the considered benchmark test functions, *LSMO* converge faster than the considered algorithms.

The boxplots analyses have also been carried out for all the considered algorithms for comparison regarding consolidated performance. In boxplot analysis tool [27] graphical distribution of empirical data is efficiently represented. The boxplots for *LSMO* and other considered algorithms are represented in Fig. 5. It is clear from this figure that *LSMO*

performs better than the considered algorithms as interquartile range, and the median is quite low.

6 Capacitor sizing and optimal placement problem

The placement of capacitors in the distribution network is mainly needed, for improving power transfer capability, for properly serving to reactive loads, for the smooth working of power transformers, and for secure and stable transmission system in different network configurations. Further, these capacitors improve voltage profile and maintain contractual obligations for electrical equipments. The capacitors also help in reducing the energy consumption of voltage-dependent sources as well as technical losses [6]. The capacitors have been widely installed by utilities, to provide reactive power compensation, to enhance the efficiency of the power distribution, and to achieve deferral of construction. Economically, we can say that the capacitors installation in distribution network help in increasing, generation capacity, transmission capacity, and distribution substation capacity. Subsequently, it helps in increasing revenue generation. But the placement of capacitors exactly at required optimal position in a distribution system is a challenging task or can say a difficult problem for the distribution engineers. The objective of this problem is to minimize the energy losses while considering the capacitor installation costs. In other words, the goal is to achieve the optimal placement and sizing of capacitors with the system constraints in the distribution network. The problem is defined as follows:

The total loss in a distribution system having n number of branches is given by

$$PL_t = \sum_{i=1}^n [I_i^2] R_i \quad (13)$$

Here I_i and R_i are current magnitude and resistances respectively for the i th branch. The branch current obtained from load flow solution has two components; active (I_a) and reactive (I_r). In active and reactive branch currents, the associated losses are given by Eqs. 14 and 15 respectively.

$$PL_a = \sum_{i=1}^n [I_{ai}^2] R_i \quad (14)$$

$$PL_r = \sum_{i=1}^n [I_{ri}^2] R_i \quad (15)$$

In loss minimization technique of the capacitor placement, a single capacitor is repetitively placed by varying its size for determining a sequence of nodes in view of loss minimization of the distribution system. The concept of loss minimization

Table 3 Comparison based on Mann–Whitney U rank sum test at significant level $\alpha = 0.05$ and average number of function evolutions

TP	LSMO vs SMO	LSMO vs LFABC	LSMO vs MeABC	LSMO vs GABC	LSMO vs ABC	LSMO vs PLSMO	LSMO vs CMA-ES	LSMO vs PSO-2011	LSMO vs DE
f_1	+	+	+	+	+	+	+	+	+
f_2	+	+	-	+	+	+	+	+	+
f_3	+	+	+	+	+	+	+	+	+
f_4	+	+	+	+	+	+	+	+	+
f_5	+	+	+	+	+	+	+	+	+
f_6	+	+	+	+	+	+	+	+	+
f_7	+	+	+	+	+	+	+	+	+
f_8	+	+	+	+	+	-	+	+	-
f_9	+	+	+	+	+	+	+	+	+
f_{10}	-	+	-	+	+	+	+	+	+
f_{11}	+	+	-	+	+	+	+	+	+
f_{12}	+	+	+	+	+	+	+	+	+
f_{13}	-	+	+	+	-	-	+	+	-
f_{14}	+	+	+	+	-	-	+	+	+
f_{15}	+	+	+	+	-	-	+	+	+
f_{16}	+	+	-	+	+	-	+	+	+
f_{17}	-	+	-	+	+	+	+	+	+
f_{18}	+	+	+	+	+	+	+	+	+
f_{19}	-	+	+	+	-	-	-	+	-
f_{20}	-	+	-	+	-	+	+	+	+
f_{21}	-	+	-	+	-	-	+	+	+
f_{22}	-	+	+	+	-	+	+	+	+
f_{23}	+	+	+	+	+	-	+	+	+
f_{24}	+	+	+	+	+	+	+	+	+
f_{25}	+	+	+	+	+	-	+	+	-
Total No. of + sign	18	24	18	24	18	17	22	21	21

TP test problem

Table 4 Comparison based on acceleration rate (AR)

TP	LSMO vs SMO	LSMO vs LFABC	LSMO vs MeABC	LSMO vs GABC	LSMO vs ABC	LSMO vs PLSMO	LSMO vs CMA-ES	LSMO vs PSO-2011	LSMO vs DE
f_1	1.24	1.64	1.34	1.41	2	1.29	3.1	3.74	2.2
f_2	1.3	1.16	0.67	1.01	1.16	1.35	2.53	3.94	2.52
f_3	1.15	1.25	1.45	1.18	1.78	1.2	3.58	3.52	2.03
f_4	1.28	1.62	1.39	1.41	2.1	1.33	3.23	3.5	2.2
f_5	1.11	1.47	1.5	1.31	1.98	1.14	3.49	3.36	2.14
f_6	1.38	1.69	1.57	1.5	2.12	1.43	3.57	4.14	2.42
f_7	1.38	2.01	1.21	2.49	4.35	1.42	13.87	2.57	2.11
f_8	7.72	1.8	1.01	9.09	9.09	4.95	0.54	3.09	0.79
f_9	1.15	1.31	1.4	1.2	1.73	1.2	2.65	3.46	2.02
f_{10}	0.97	0.88	0.68	0.76	1.14	1.41	2.2	2.06	1.15
f_{11}	1.28	1.14	0.86	0.97	1.48	1.46	2.22	3.51	1.75
f_{12}	1.43	1.73	1.66	1.55	2.24	1.47	3.72	4.1	2.54
f_{13}	0.88	2.14	1.47	5.34	9.2	0.75	0.45	1.55	0.82
f_{14}	2.86	3.41	1.56	10.35	10.47	0.93	0.43	2.67	1.29
f_{15}	1.16	1.63	1.1	2.48	4.82	0.96	0	1.03	1.85
f_{16}	1.66	2	0.98	0.89	0.95	1.61	0.18	4.25	1.47
f_{17}	0.97	1.01	0.91	0.91	1.48	1	1.58	2.57	1.7
f_{18}	1.03	1.24	1.13	1.05	1.91	1.08	1.97	2.8	1.76
f_{19}	0.81	0.96	3.78	2.94	12.34	0.82	0.65	0.66	0.32
f_{20}	0.87	0.49	0.55	0.56	1.01	0.87	1.22	3.48	1.49
f_{21}	0.92	0.74	0.71	0.77	1.51	0.91	0.32	1.78	1.21
f_{22}	0.83	1.46	1.66	2.06	13.58	0.82	60.79	1.37	3.35
f_{23}	10.55	1.44	2.44	3.16	3.31	1.78	0.93	11.82	13.06
f_{24}	1.14	1.49	1.5	1.32	2.07	1.19	6.63	3.48	1.97
f_{25}	1.19	2.16	2.17	2.17	2.17	1.08	0.99	0.9	0.72

TP test problem

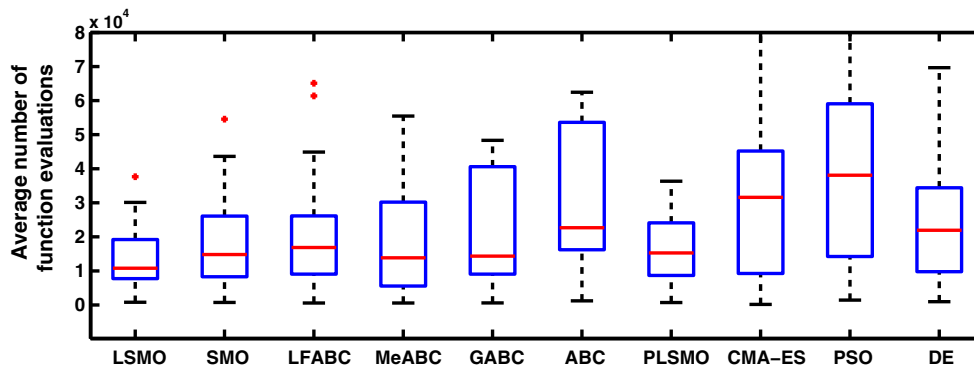


Fig. 5 Boxplots graphs for average number of function evaluation

by a singly located capacitor can be extended for multiple capacitors [6].

Let us consider the following [13]:

- m = number of capacitor buses.
- $I_c = m$ dimensional vector consisting of capacitor currents.
- α_j = set of branches from the source bus to the j^{th} capacitor bus ($j = 1, 2, \dots, m$).
- D = a matrix of dimension $n \times m$.

The elements of D are considered as

- $D_{ij} = 1$; if branch $i \in \alpha$
- $D_{ij} = 0$; otherwise

When the capacitors are placed in the system, the new reactive component of branch currents is given by

$$[I_r^{new}] = [I_r] + [D][I_c] \tag{16}$$

The loss associated with the new reactive currents in the compensated system is

$$P_{L_r}^{com} = \sum_{i=0}^n (I_{ri} + D_{ij}I_{cj})^2 R_i \tag{17}$$

The loss saving (S) is obtained by placing the optimal size capacitors in the distribution network. The loss saving is calculated by taking the difference of the Eqs. 15 and 17 and is shown as follows:

$$S = - \sum_{i=1}^n \left[\left(2I_{ri} \sum_{j=1}^m D_{ij}I_{cj} + \sum_{j=1}^m D_{ij}I_{cj} \right)^2 \right] R_i \tag{18}$$

For achieving the maximum loss saving, optimal capacitor currents can be obtained from the following equations:

$$\begin{aligned} \frac{\delta S}{\delta I_{c1}} &= 0 \\ \frac{\delta S}{\delta I_{c2}} &= 0 \\ &\dots \\ &\dots \\ \frac{\delta S}{\delta I_{ck}} &= 0 \end{aligned} \tag{19}$$

After some mathematical manipulations, equation 19 can be expressed by a set of linear algebraic equations as follows:

$$[A][I_c] = [B] \tag{20}$$

Where A is a $m \times m$ square matrix and B is a k -dimensional vector. The elements of A and B are given by

$$A_{jj} = \sum_{i \in \alpha_j} [R_i] \tag{21}$$

$$A_{jj} = \sum_{i \in (\alpha_j \cap \alpha_m)} [R_i] \tag{22}$$

$$B_j = \sum_{i \in \alpha_j} [I_{ri} R_i] \tag{23}$$

Only the branch resistances and reactive currents in the original system are required to find the elements of A and B . The capacitor currents for the highest loss saving can be obtained from Eq. 20.

$$[I_c] = [A]^{-1}[B] \tag{24}$$

Once the capacitor currents are known, the optimal capacitor sizes can be written as Q_c in mega volt ampere reactive (MVAR) as equation 25

Table 5 Optimal placement and sizing of capacitor for IEEE 14 bus 3 capacitor problem

Sr. no.	Optimal placement of capacitors on bus by GA	Optimal placement of capacitors on bus by SMO	Optimal placement of capacitors on bus by LSMO	Size of capacitors by GA (MVAR)	Size of capacitors by SMO (MVAR)	Size of capacitors by LSMO (MVAR)	Loss uncapacitor (MW)	Loss by GA (MW)	Loss by SMO (MW)	Loss by LSMO (MW)
1	6	14	13	14.642	10	10	13.533	13.282	13.285196	13.276
2	13	5	5	10.476	27.787	25.461	13.533	13.282	13.285196	13.276
3	9	9	9	41.771	21	22.567	13.533	13.282	13.285196	13.276

Table 6 Optimal placement and sizing of capacitor for IEEE 14 bus 5 capacitor problem

Sr. no.	Optimal placement of capacitors on bus by GA	Optimal placement of capacitors on bus by SMO	Optimal placement of capacitors on bus by LSMO	Size of capacitors by GA (MVAR)	Size of capacitors by SMO (MVAR)	Size of capacitors by LSMO (MVAR)	Loss uncapacitor (MW)	Loss by GA (MW)	Loss by SMO (MW)	Loss by LSMO (MW)
1	14	14	13	13.353	10	10	13.533	13.318	13.275771	13.271
2	10	3	3	46.426	23.855	25.510	13.533	13.318	13.275771	13.271
3	10	2	2	17.356	12.770	10.071	13.533	13.318	13.275771	13.271
4	5	6	6	33.008	21.856	15.726	13.533	13.318	13.275771	13.271
5	3	9	9	21.209	41.698	45.469	13.533	13.318	13.275771	13.271

Table 7 Optimal placement and sizing of capacitor for IEEE 30 bus 3 capacitor problem

Sr. no.	Optimal placement of capacitors on bus by GA	Optimal placement of capacitors on bus by SMO	Optimal placement of capacitors on bus by LSMO	Size of capacitors by GA (MVAR)	Size of capacitors by SMO (MVAR)	Size of capacitors by LSMO (MVAR)	Loss uncapacitor (MW)	Loss by GA (MW)	Loss by SMO (MW)	Loss by LSMO (MW)
1	6	22	24	40.204	22	10.507				
2	22	7	21	10.476	10	16.051	17.944	17.531	17.480194	17.396
3	24	4	4	13.127	41	35.083				

Table 8 Optimal placement and sizing of capacitor for IEEE 30 bus 5 capacitor problem

Sr. no.	Optimal placement of capacitors on bus by GA	Optimal placement of capacitors on bus by SMO	Optimal placement of capacitors on bus by LSMO	Size of capacitors by GA (MVAR)	Size of capacitors by SMO (MVAR)	Size of capacitors by LSMO (MVAR)	Loss uncapacitor (MW)	Loss by GA (MW)	Loss by SMO (MW)	Loss by LSMO (MW)
1	6	17	17	17.569	10	10				
2	3	4	4	20.395	26.780	25.090				
3	21	3	3	17.356	10	10	17.944	17.489	17.355102	17.348
4	20	24	24	13.008	11.292	11.320				
5	13	21	21	41.209	10	10				

Table 9 Optimal placement and sizing of capacitor for IEEE 33 bus 3 capacitor problem

Sr. no.	Optimal placement of capacitors on bus by GA	Optimal placement of capacitors on bus by SMO	Optimal placement of capacitors on bus by LSMO	Size of capacitors by GA (MVAR)	Size of capacitors by SMO (MVAR)	Size of capacitors by LSMO (MVAR)	Loss uncapacitor (MW)	Loss by GA (MW)	Loss by SMO (MW)	Loss by LSMO (MW)
1	12	29	29	45.971	43.896	43.896				
2	28	13	13	43.734	44.000	44.000	178.735	165.840	165,422331	165.42
3	13	12	12	45.805	43.447	43.474				

Table 10 Optimal placement and sizing of capacitor for IEEE 33 bus 5 capacitor problem

Sr. no.	Optimal placement of capacitors on bus by GA	Optimal placement of capacitors on bus by SMO	Optimal placement of capacitors on bus by LSMO	Size of capacitors by GA (MVAR)	Size of capacitors by SMO (MVAR)	Size of capacitors by LSMO (MVAR)	Loss uncapacitor (MW)	Loss by GA (MW)	Loss by SMO (MW)	Loss by LSMO (MW)
1	30	29	25	49.845	45.052	47				
2	12	12	11	40.395	45.000	47				
3	13	11	13	46.002	45.697	47	178.735	158.052	157,668728	151.287
4	22	13	12	47.682	48.000	48				
5	29	25	29	47.175	44.035	46				

$$Q_c = V_m \times I_c \tag{25}$$

Here V_m is the voltage magnitude vector of capacitor buses. The saving in the compensated system can be estimated from Eq. 18 using the value of I_c given by Eq. 24.

The objective function may be formulated using Eq. 18 in following manner :

$$\text{minf} (x_{\text{location}}, x_{\text{size}}) = S \tag{26}$$

7 LSMO for optimal placement and sizing of capacitors

In this section, the LSMO and SMO algorithms are applied to solve the optimal placement and sizing problem of capacitors in the distribution network. First in LSMO, the solutions

are generated randomly in a given range i.e. capacitors of given value are placed at random nodes in the distribution system. Here, each solution represents the size and location of capacitors in the distribution network, for example for 3-capacitor problem; a solution will be of six dimensions of which first three will represent the size of the capacitors while remaining three will show the locations of the capacitors. Here, it should be noted that the locations of the capacitors are represented by discrete values while size by continues values. Therefore, the first three real values are converted into discrete values by rounding off in the nearby integer value. In this way, a mixed representation of the solution is prepared. As the capacitor placement and the sizing problem is non-separable and multimodal in nature, SMO and its proposed variant are applied to solve it. In this paper, the loss minimization is carried out by providing the optimal size and location of the capacitors in the

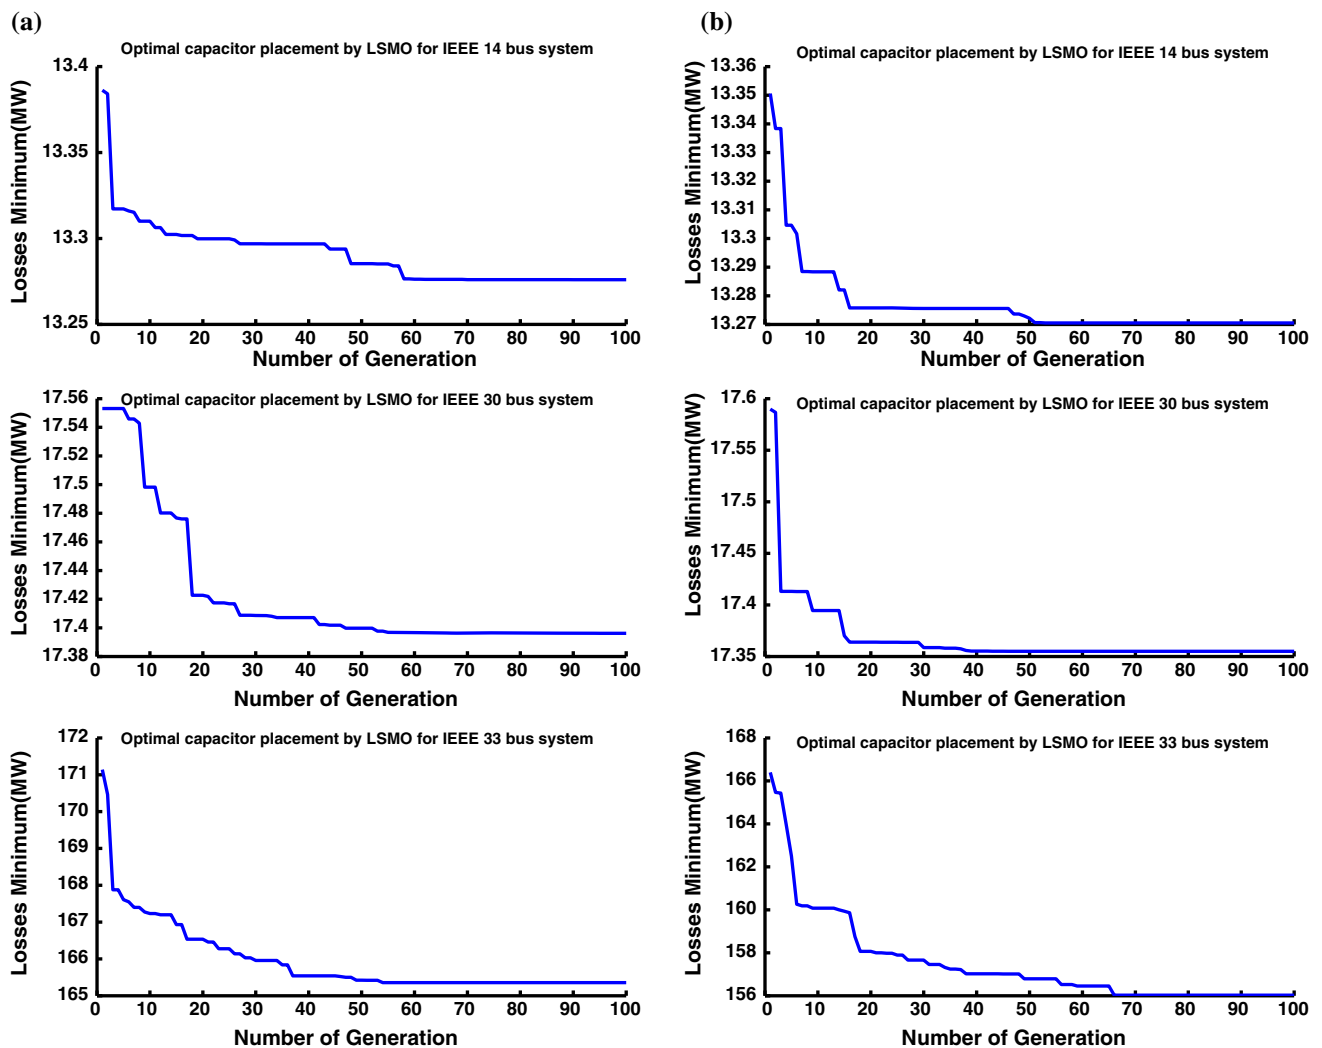


Fig. 6 LSMO for Optimal placement of capacitor of IEEE–14, IEEE–30 and IEEE–33 bus system respectively for a 3 capacitor, b 5 capacitor problems

network. For testing, the performance of LSMO, it is applied on IEEE–14, 30 and 33 test bus radial distribution system. The LSMO is used to update the bus data of the considered bus systems iteratively for reducing the system losses. The reported results are compared with GA and SMO (The parameter settings of GA and SMO are same as their legitimate research papers [2,8]) as shown in Tables 5, 6, 7, 8, 9, and 10. The better results are represented by bold values. The loss minimization curves are shown in Fig. 6. From these tables, it is clear that the size of the capacitor is determined in MVAR (i.e. 10^6 VAR) while power loss is measured in Mega Watts (i.e. 10^6 W). So, a little difference in power loss and capacitor size affects the performance significantly. The results show that the loss occurred using LSMO strategy is minimum among all the considered cases and algorithms. Therefore, the LSMO may be used for solving the capacitor placement and sizing problem of the distribution system.

8 Conclusion

In this paper, a limaçon inspired local search (LLS) strategy is developed and hybridized with SMO. The proposed hybridized strategy is named as limaçon inspired SMO (LSMO). The performance of LSMO has evaluated over 25 well-known benchmark functions. Results indicate that the proposed LSMO is a significant candidate among most promising swarm intelligence based global optimization algorithms. Further, a complex real-world optimization problem, optimal placement and sizing of capacitors in distributed network is solved with IEEE 14, 30, and 33 bus test system using LSMO. Results have been compared with those of GA and SMO. It is observed that LSMO obtains minimum distribution and transmission losses while maintaining the minimum cost. This work may further be extended to an unbalanced radial system as a future research perspective.

References

- Bansal JC, Sharma H, Arya KV, Nagar A (2013) Memetic search in artificial bee colony algorithm. *Soft Comput* 17(10):1911–1928
- Bansal JC, Sharma H, Jadon SS, Clerc M (2014) Spider monkey optimization algorithm for numerical optimization. *Memet Comput* 6(1):31–47
- Chen X, Ong YS, Lim MH, Tan KC (2011) A multi-facet survey on memetic computation. *IEEE Trans Evolut Comput* 15(5):591–607
- Clerc M, Kennedy J (2011) Standard pso 2011. Particle swarm central site [online] <http://www.particleswarm.info>. Accessed Feb 2015
- Lawrence JD (1972) A catalog of special plane curves. Dover Publications, New York
- Gallejo R, Monticelli AJ, Romero R (2001) Optimal capacitor placement in radial distribution networks. *Power Syst IEEE Trans* 16(4):630–637
- Hansen N (2006) The cma evolution strategy: a comparing review. In: Lozano JA, Larranaga P, Inza I, Bengoetxea E (eds) *Towards a new evolutionary computation*, vol 192. Springer, Berlin, Heidelberg, pp 75–102
- Holland JH (1975) *Adaptation in natural and artificial systems: an introductory analysis with applications to biology, control, and artificial intelligence*. U. Michigan Press, Oxford, England
- Isac SJ, Kumar KS (2015) Optimal capacitor placement in radial distribution system to minimize the loss using fuzzy logic control and hybrid particle swarm optimization. In: *Power electronics and renewable energy systems*, vol 326, c. kamalakannan edition. Springer India, pp 1319–1329
- Karaboga D (2005) An idea based on honey bee swarm for numerical optimization. Technical report TR06, Erciyes University Press, Erciyes
- Krasnogor N, Gustafson S (2002) Toward truly “memetic” memetic algorithms: discussion and proofs of concept. In: *Advances in nature-inspired computation: the PPSN VII workshops. PEDAL (Parallel, Emergent and Distributed Architectures Lab)*. University of Reading. ISBN 0-9543481-0-9. icalp. tex; 9/12/2003; 16: 52, Natalio Krasnogor, Steven Gustafson. Citeseer, pp 21–22
- Krivoshapko S, Ivanov VN (2015) *Encyclopedia of analytical surfaces*. Springer, Switzerland
- Kumar P, Singh AK (2015) Soft computing techniques for optimal capacitor placement. In: Zhu Q, Azar AT (eds) *Complex system modelling and control through intelligent soft computations*. Springer, pp 597–625
- Lee CS, Ayala HVH, dos Santos Coelho L (2015) Capacitor placement of distribution systems using particle swarm optimization approaches. *Int J Electr Power Energy Syst* 64:839–851
- Lim MH, Gustafson S, Krasnogor N, Ong YS (2009) Editorial to the first issue. *Memet Comput* 1(1):1–2
- Mininno E, Neri F (2010) A memetic differential evolution approach in noisy optimization. *Memet Comput* 2(2):111–135
- Neri F, Tirronen V (2009) Scale factor local search in differential evolution. *Memet Comput* 1(2):153–171
- Ng HN, Salama MMA, Chikhani AY (2000) Capacitor allocation by approximate reasoning: fuzzy capacitor placement. *Power Deliv IEEE Trans* 15(1):393–398
- Nguyen QH, Ong YS, Lim MH (2009) A probabilistic memetic framework. *IEEE Trans Evolut Comput* 13(3):604–623
- Ong YS, Lim M, Chen X (2010) Research frontier: memetic computation—past, present and future. *Comput Intell Mag IEEE* 5(2):24–31
- Ong YS, Lim MH, Zhu N, Wong KW (2006) Classification of adaptive memetic algorithms: a comparative study. *Syst Man Cybern Part B: Cybern IEEE Trans* 36(1):141–152
- Ong YS, Nair PB, Keane AJ (2003) Evolutionary optimization of computationally expensive problems via surrogate modeling. *AIAA J* 41(4):687–696
- Prakash K, Sydulu M (2007) Particle swarm optimization based capacitor placement on radial distribution systems. In: *Power Engineering Society general meeting, 2007. IEEE, Tampa*, pp 1–5
- Rao RS, Narasimham SVL, Ramalingaraju M (2008) Optimization of distribution network configuration for loss reduction using artificial bee colony algorithm. *Int J Electr Power Energy Syst Eng* 1(2):116–122
- Sharma A, Sharma H, Bhargava A, Sharma N (2016) Power law-based local search in spider monkey optimisation for lower order system modelling. *Int J Syst Sci* 1–11. doi:10.1080/00207721.2016.1165895
- Sharma H, Bansal JC, Arya KV (2013) Opposition based lévy flight artificial bee colony. *Memet Comput* 5(3):213–227

27. Sharma H, Bansal JC, Arya KV, Yang X-S (2015) Lévy flight artificial bee colony algorithm. *Int J Syst Sci* 47(11):1–19
28. Storn R, Price K (1997) Differential evolution—a simple and efficient heuristic for global optimization over continuous spaces. *J Glob Optim* 11(4):341–359
29. Sundhararajan S, Pahwa A (1994) Optimal selection of capacitors for radial distribution systems using a genetic algorithm. *Power Syst IEEE Trans* 9(3):1499–1507
30. Vermeij GJ (1995) *A natural history of shells*. Princeton University Press, Princeton New Jersey, USA
31. Zhu G, Kwong S (2010) Gbest-guided artificial bee colony algorithm for numerical function optimization. *Appl Math Comput* 217(7):3166–3173